

POWER QUALITY OF SUPPLY CHARACTERIZATION IN THE PORTUGUESE ELECTRICITY TRANSMISSION GRID

Luis CAMPOS PINTO

REN – Rede Eléctrica Nacional, S.A. – Portugal
campospinto@ren.pt

Alexandra TAVARES

REN – Rede Eléctrica Nacional, S.A. – Portugal
alexandra.tavares@ren.pt

ABSTRACT

REN – Rede Eléctrica Nacional S.A., as the concessionaire of the Portuguese National Electricity Transmission Grid (RNT), has an important role in electrical energy quality to the final customer. Continuity of supply general/individual indicators and parameters are defined in accordance to the regulatory legislation stated in the Portuguese Quality of Service Regulation (RQS). Voltage quality assessment is done by REN and is based on a monitoring plan that includes voltage characteristics measurement at selected delivery and internal points.

A study was conducted in order to characterize all the bus bars that were monitored between 2010 and 2011. It was used a simple methodology based on labeling the power quality. On this paper, it will be shown this methodology and the results obtained in characterizing the delivery points of the Portuguese Electricity Transmission Grid (RNT) for the period 2010-2011, as well as other REN quality of supply results in the last years.

INTRODUCTION

REN – Rede Eléctrica Nacional S.A. (REN) holds the concession to operate the National Electricity Transmission Grid (RNT). It provides a public utility service in mainland Portugal, as the Transmission System Operator (TSO). It holds as main functions: the management of technical aspects of the National Electricity System (SEN); the transmission of electricity; the management of the interconnections with neighbouring TSO; planning, design, construction, operation and maintenance of the RNT; the identification of needs of new power production centres; the study of potential sites for new generation centres; and the global management of the Electricity System of the Public Service (SEP) [1].

REN, as the concessionaire of RNT, has an important role in the electrical energy quality to the final customer.

Voltage quality assessment is done by REN and is based on a monitoring plan that includes voltage characteristics measurement at selected delivery and internal points, such as: harmonic distortion, flicker, voltage unbalance, rms voltage, frequency and voltage dips.

A study was conducted in order to characterize all the bus bars that were monitored between 2010 and 2011. A simple methodology was used based on labeling the power quality. This methodology is similar to the classification that is

already in use to define levels of energy efficiency of household appliances. Using this method, it is possible to: aggregate large amounts of measured data into a single indicator; quickly identify areas of RNT best and worst performance for each voltage level; communicate with customers providing simple and understandable information; obtain guidance for future revisions of the Portuguese Quality of Service Regulation (RQS) and for the establishment of power quality contracts with customers.

GENERAL INFORMATION

Portuguese Electricity Transmission Grid

By the end of 2012, the transmission lines total length was 8525 km (81.4 km of underground cables), with 2333 km of 400 kV, 3513 km of 220 kV and 2679 km of 150 kV.

The transmission grid had 64 substations, 13 switching stations, 187 power transformers and autotransformers and 1294 bays, with a total installed capacity of 33765 MVA.

Supply Characterization

The forecast for total consumption in 2012 is approximately 49 TWh. RNT had 79 delivery points: EHV - extremely high voltage grid (220 kV and 150 kV) – 20; HV - high voltage grid (60 kV) – 59.

Grid Evolution

In the last six years, the RNT registered a considerable evolution. From 2007 to 2012, the number of substations and switching stations rose by 22%. The number of power transformers and transmission lines also registered a significant increase, with 28% for power transformers and 15% for transmission lines total length.

QUALITY OF SUPPLY

The quality of supply global level depends on the number of incidents that affect the transmission grid, having in account the correlation with climatic conditions.

Despite the increase on the principal RNT elements (transmission lines and substations) in the same period (2007-2012) the incidents number had a significant decrease of 22.8%.

Between 2007 and 2012, approximately 80-85% of incidents had origin in overhead lines. The principal causes were: birds (white storks), lightning, forest fires and industrial and saline pollution, in association with fog and mist.

Continuity of Supply

The continuity of supply is the grid permanent capacity to deliver electricity to all customers. When this capacity is not guaranteed, it means that a supply interruption takes place. In some situations, a load shedding can occur. The continuity of supply indicators and parameters are defined in accordance to the regulatory legislation stated in the Portuguese Quality of Service Regulation (RQS) [2]. The general indicators are related with the global performance of the transmission grid. The annual determination of these indicators and parameters allows verifying their evolution and to take the necessary corrective measures in a perspective of power quality improvement. The general indicators are the following: Energy Not Supplied (ENS), Average Interruption Time (AIT), System Average Interruption Frequency Index (SAIFI), System Average Interruption Duration Index (SAIDI) and System Average Restoration Time Index (SARI). The individual indicators, related with the performance of the transmission grid in each delivery point, are: Interruption Duration (ID) and Interruption Frequency (IF). If the parameters for individual indicators are not respected, the company has the obligation to pay compensation to the clients.

For continuity of supply general and individual standards verification only the interruptions with more than 3 minutes are considered and are excluded all interruptions caused by fortuitous reasons or “force majeure”, public interest reasons, service reasons, security reasons, circumstances attributable to customers and agreements with customers.

Continuity of Supply Indicators – Results

For REN, 2012 will be remembered as an historical year regarding Quality of Service because, for the first time, there were no supply interruptions above 3 minutes, achieving a sustained improvement on RNT performance. Concerning this fact, in 2012 the AIT was the best result ever. On the same way, the other indicators (ENF, SAIFI, SAIDI and SARI) reached best results.

The excellent values obtained in 2012 are a consequence of the way the grid is planned, as well as the operation and maintenance measures. The “meshed” grid characteristic with adequate maintenance measures and policies leads to a minimization of the incidents consequences that affect customers.

Voltage Quality

The voltage waveform quality is affected by some types of disturbances, such as:

- Continuous disturbances that affect the voltage waveform nominal characteristics: frequency variations, slow voltage variation, fast voltage variation (flicker), unbalance, harmonics. These phenomena are mainly caused by grid installations that have non-linear loads or significant load variations;
- Momentary disturbances, in addition to a singular event, that results on voltage waveform nominal

significant characteristics variations: voltage dips and temporary or transient over voltages. This situation occurs in addition to faults in elements of the grid or external factors (environmental and atmospheric events, third party actions, etc.).

Monitoring Plan of the Voltage Quality

Following the RQS, REN is obliged to monitor all delivery points over a period of two years. The monitoring plan allows verifying the accomplishment of technical standards and is constituted by a set of measurements to carry through RNT and delivery points. These measurements are taken at substation bus bars using fixed equipment (fixed Acquisition Remote Units) installed in the transmission grid and mobile equipment (mobile Acquisition Remote Units) to record possible disturbances.

The monitoring plan is designed having as purposes: to cover all the regions in the country and the different voltage levels in RNT; to coordinate the measurements on RNT strategic points (including interconnections with Spain) with the distribution operator measurements in order to determine the disturbances origin; and the identification of new actions concerning the previous results. REN sends to the regulator quarterly reports, files with quality of supply indicators and parameters and an annual report, according to RQS.

Voltage Quality Results

In general, the disturbances average values are relatively low and the (indicative) regulatory limits are fulfilled in more or less 92% of delivery points.

The majority of the voltage dips had durations lower than 250 milliseconds and dip amplitude of 30% of the rms voltage value. These results are globally acceptable.

Labelling Power Quality

Many customers are not familiar with power quality concepts. That is why it is so important to kept information very simple and understandable. In addition to this, DNOs (Distribution Network Operators) in the Netherlands have initiated an easy classification system based on labeling the power quality [4], [5]. This system is already in use to classify the energy efficiency of household appliances. On Fig.1 it is possible to see the classification levels.



Fig. 1. Classification of power quality characteristics

First, it is necessary to normalize all power quality characteristics level, using the following formula:

$$r_{(c,b,p)} = 1 - \frac{m_{(c,b,p)}}{l_{(c)}} \quad (2)$$

where, $r_{(c,b,p)}$ is the normalized power quality characteristic c , on bus bar b , for phase p ; $m_{(c,b,p)}$ is the actual level of characteristic c , on bus bar b , for phase p ; and $l_{(c)}$ is the compatibility level of characteristic c .

The normalized value will be: 1 ($m=0$) if there is no disturbance; 0 if the disturbance level is equal to the applicable standard; negative if the disturbance level exceeds the specified limit.

However, the previous equation is not applicable to voltage dips on the Portuguese reality. In Portugal there are no standard limits for voltage dips, that is why it is not possible to use the formula above. Nevertheless, a comparison analysis of all the bus bars was made. The following methodology was used [6]:

1° It was attributed a weighting factor for each voltage dip based on the amplitude and duration (severity) of the dip

$$S_e = \frac{1-U}{1-U_{ref}(d)} \quad (3)$$

where, U is the voltage amplitude (% of nominal voltage); d is the duration (severity); and $U_{ref}(d)$ is the voltage amplitude reference for duration d . The reference curve recommended for this method is the SEMI (Semiconductor Equipment and Materials International Group) curve, which is a variant of the ITI curve;

2° The following step is the ratio of the sum of severities of all dips by the considered monitoring periods, for each bus bar. This step leads to an average value per period;

3° For the best and the worst bus bars (2nd step) we assume that the normalized value is +1 and -1;

4° Having in account the previous step and the first equation, the reference value for the grid is achieved by the average of the best and the worst values;

5° Using the equation (2), where $m_{(c,b,p)}$ is the individual result for each bus bar (2nd step) and $l_{(c)}$ the reference value (4th step), we obtain the classification $r_{(c,b,p)}$ for each bus bar. However, it is important to clarify that this classification only allows evaluating the bus bars relative performance. It is not possible to compare these results with other grids.

Results

The focus of analysis was the period 2010-2011. REN monitoring annual plans included measurements of:

- Permanent remote units (26 installations) with voltage levels characteristics measurements during 52 weeks per year;
- Periodic remote units, installed in a way that allows taking a global view of the RNT voltage quality (in 4 weeks periods).

The results obtained were of two types: continuous phenomena characteristics and short-duration events

(voltage dips). The continuous phenomena data are made by the weekly 95th percentile (of all weeks and bus bars that were monitored). There were considered two levels of 95th percentile: the maximum value and the median value. This methodology allows reaching two different results: the less favorable week and the representative week classifications, over the year of measurements.

For voltage dips it was used the method that was previously mentioned. It was only considered bus bars with permanent remote units. Measuring periods lower than one year does not allow reaching consistent values because of the dips seasonality. This is why periodic remote unit measurements were not considered.

On the Fig. 2, there are four Portugal maps, one for each voltage level (60, 150, 220 and 400 kV). It is represented the global evaluation of RNT installations, for continuous phenomena.

This evaluation is based on the worst characteristic (the worst value of the representative week) for each measured point. These characteristics are only the ones that have normative limits.

Voltage unbalance and frequency were not considered because deviations values were not significant (weighted against the standard limits).

On the Fig. 3 it is possible to see the global value for voltage dips (for all bus bars).

CONCLUSIONS

In the last years, REN achieved an excellent performance regarding quality of supply as shown by the relevant indicators.

As many customers are not familiar with power quality concepts, it is important to kept information very simple and understandable. In addition to this, an easy classification system based on labeling the power quality was used in order to classify the voltage quality on delivery points. A similar system is already in use to classify the energy efficiency of household appliances.

Regarding global voltage quality classification for continuous phenomena there are a lot of issues related with flicker that came from steelworks, for example, in Ermesinde (SED), Vermoim (SVM) and Sines (SSN) substations. The worst example is in Alqueva substation (SAV) that shows high levels of flicker that came from a Spanish steelwork near the border.

The worst values of short-duration events are due to voltage dips that came in consequence of short-circuit or earth faults. Some of them are caused, for example, by lightning strokes (most frequent source of incidents on the RNT).

Despite all these incidents, REN promotes a detailed identification of incidents causes, a great improvement on preventive measures and a significant investment on RNT infrastructures (transmission lines and substations). This leads to great continuity of supply indicators that places REN among the most efficient European transmission

utilities.

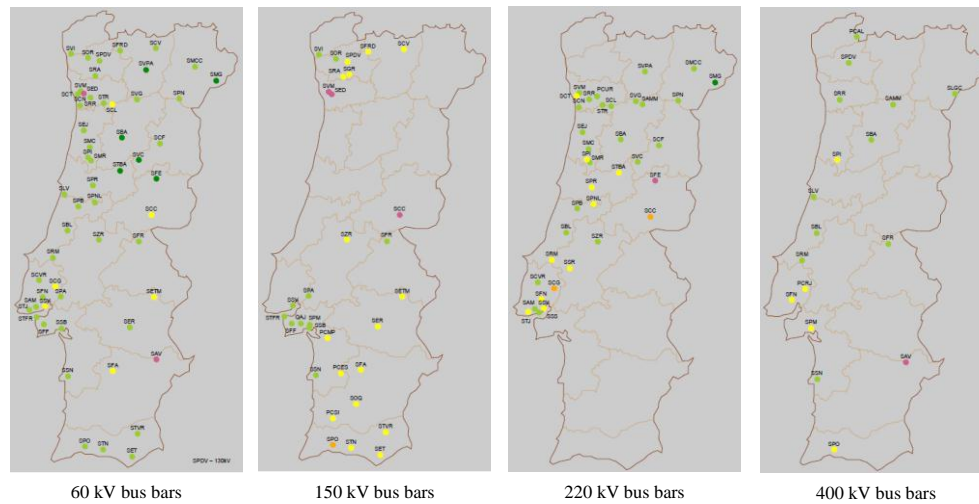


Fig. 2. Global voltage quality classification per bus bar (continuous phenomena)

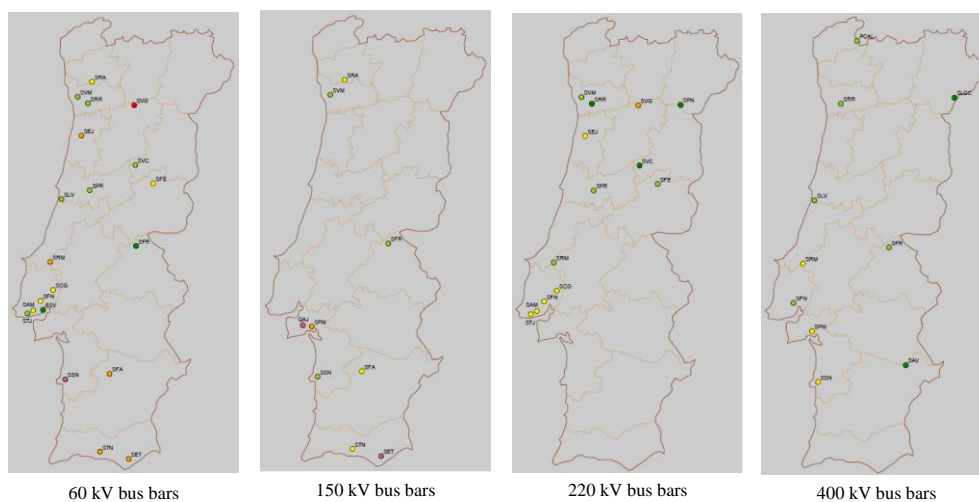


Fig. 3. Global voltage quality classification (short-duration events)

REFERENCES

- [1] A. Meneses and L. Campos Pinto, 2011, "Quality of Supply at the Portuguese Electricity Transmission Grid ", 11th *IEEE Electrical Power Quality and Utilisation*.
- [2] ERSE – Entidade Reguladora dos Serviços Energéticos, 2006, "Regulamento da Qualidade de Serviço".
- [3] European Norm EN 50160, 2010, "Voltage characteristics of electricity supplied by public electricity networks".
- [4] J.F.G. Cobben, and J.F.L. van Casteren, 2006, "Classification Methodologies for Power Quality", *Electrical Power Quality and Utilization Magazine* Vol.II, No.1.
- [5] W.T.J. Hulshorst, E.L.M. Smeets, and J.A. Wolse, 2007, "Premium Power Quality Contracts and Labeling", Work package 2 of the Quality of Supply and Regulation Project, KEMA Consulting.
- [6] A. Tavares and L. Campos Pinto, 2012, "Power Quality of Supply Characterization in the Portuguese Electricity Transmission Grid", 8th International Conference Electric Power Quality and Supply Reliability.